

PUMP Recommendation

PUMP-Rec-13 Rev C

PUMP RECOMMENDATION FOR KNIGHT 051-211 BOILER


Pump Specifications


Part No.	HorsePower	Flanges	Valute Material	Flange Material	Vendor	Vendor Product Series	Orientation
PUM3020	1/6	1"	Cast Iron	Cast Iron	Grundfos	UP Series	Vertical


Installation Specifications

Specific Model Number	Maximum Flow Rate	Planned Temperature Rise	Planned Flow Rate	Total System Head Loss
	N/A			

IMPORTANT: Read the Knight 80-285 Installation and Operation Manual. If the planned system exceeds the pump capacity in flow and/or head see "Pump Curves-All Pumps" for alternate pumps and pump curves.





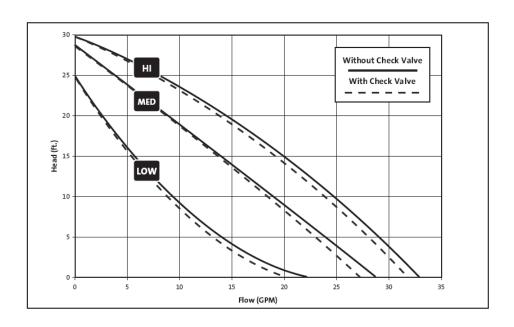



Lochinvar Corporation • 300 Maddox Simpson Pkwy • Lebanon, TN 37090 • 615-889-8900/Fax: 615-547-1000 www.Lochinvar.com



PUMPRecommendation

PUMP-Rec-13 Rev C

PUMP RECOMMENDATION FOR KNIGHT 286 BOILER


Pump Specifications


Part No.	HorsePower	Flanges	Valute Material	Flange Material	Vendor	Vendor Product Series	Orientation
PUM3021	1/6	1-1/4"	Cast Iron	Cast Iron	Grundfos	UP Series	Vertical

Installation Specifications

Specific Model Nun	nber Ma	ximum Flow Rate	Planned Temperature Rise	Planned Flow Rate	Total System Head Loss	
		N/A				

IMPORTANT: Read the Knight 80-285 Installation and Operation Manual. If the planned system exceeds the pump capacity in flow and/or head see "Pump Curves-All Pumps" for alternate pumps and pump curves.

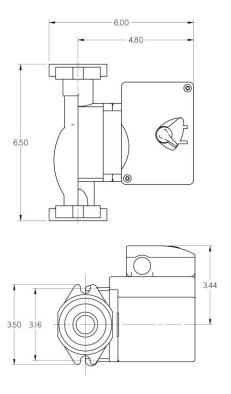

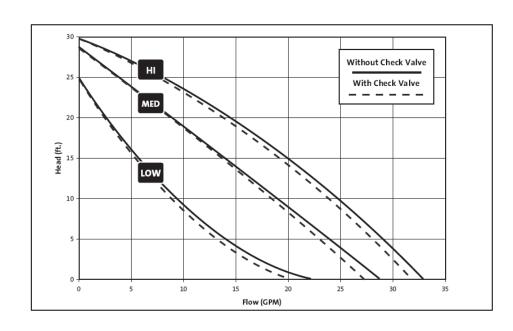



Lochinvar Corporation • 300 Maddox Simpson Pkwy • Lebanon, TN 37090 • 615-889-8900/Fax: 615-547-1000 www.Lochinvar.com